


Endura Multi-Point Astragal and Endura Ultimate Trilennium® Compatible Astragal Specifications

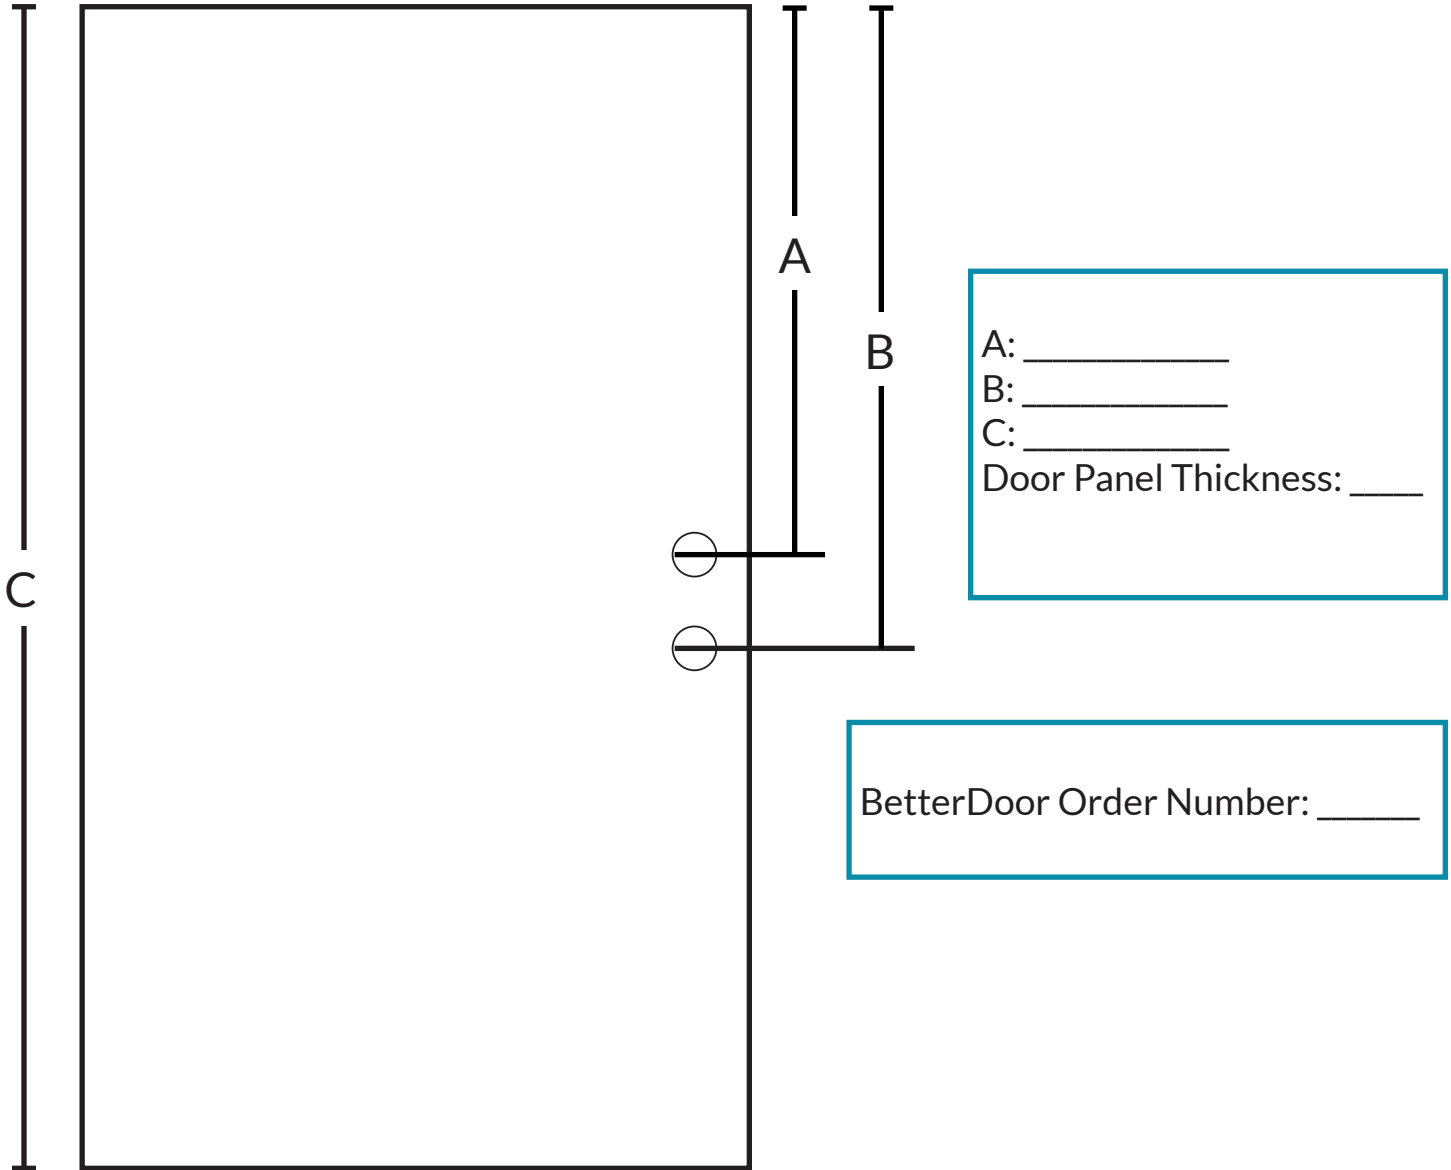

I, _____, certify that the above specifications are accurate and understand that by providing these specifications, this is a custom product. _____

I understand that in accordance with BetterDoor's return policy, custom products cannot be returned. _____

BetterDoor will manufacture this product by following the specifications provided.

Signature: _____

Date: _____